



REVISIONS	BY


FLOW DIAGRAM FOR AH-1

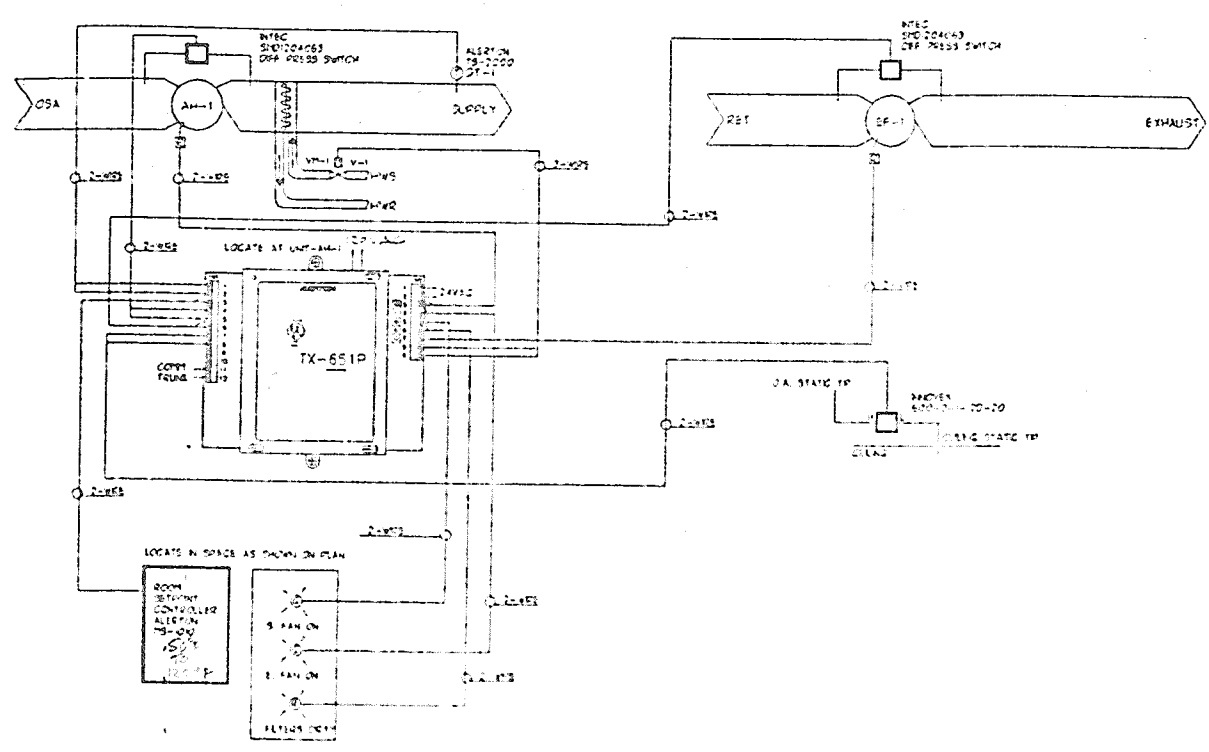


BOILER/PUMP CONTROL DIAGRAM

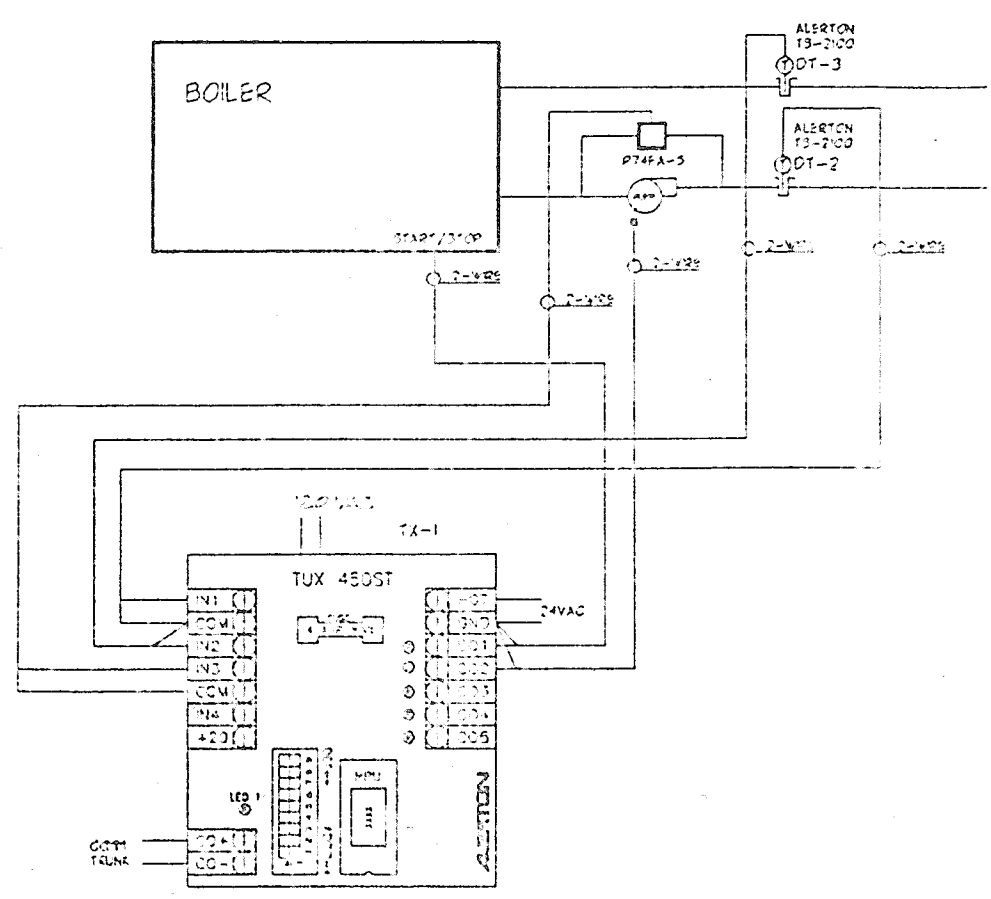


EXHAUST FAN EF-2 CONTROL DIAGRAM

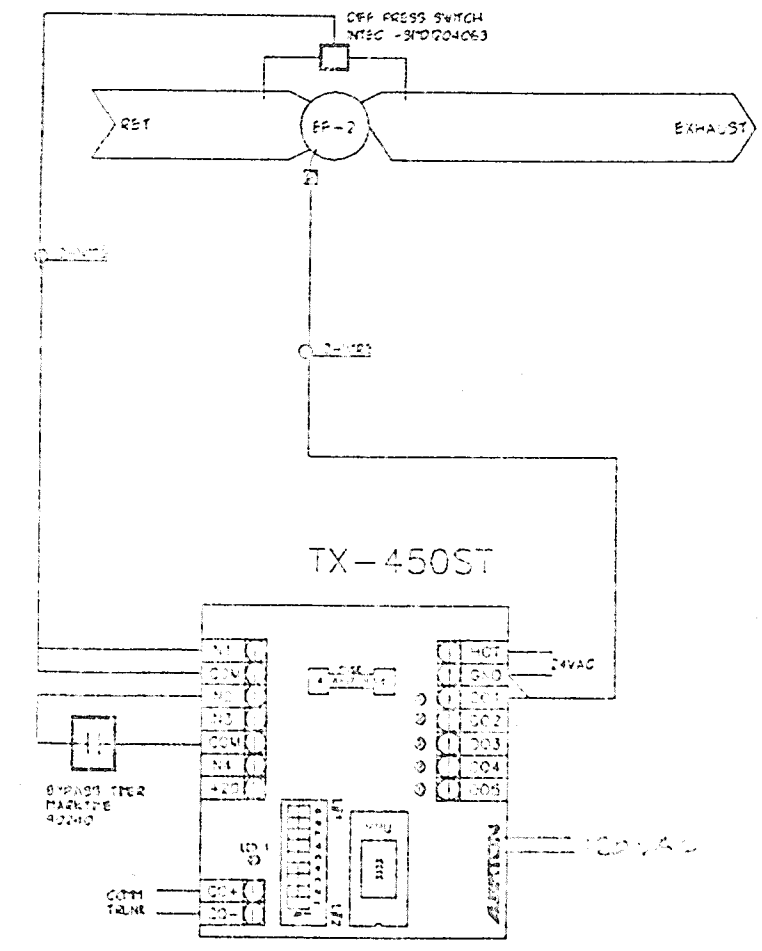

TYPICAL FLOOR PLAN

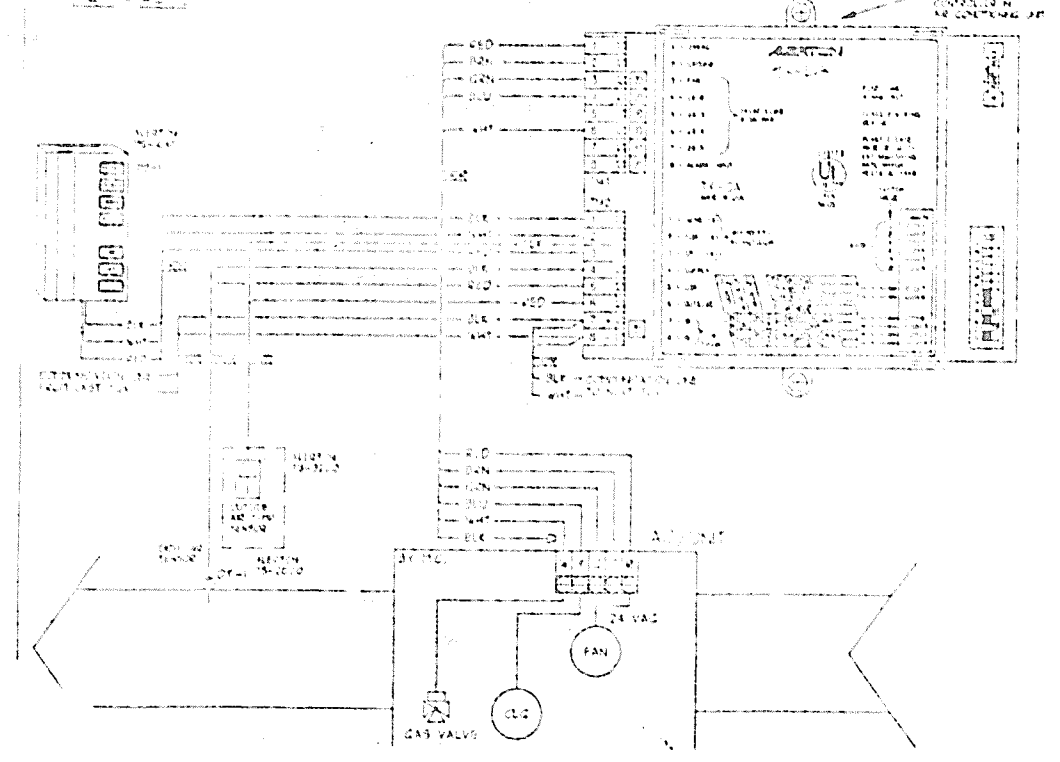

SYSTEM ARCHITECTURE

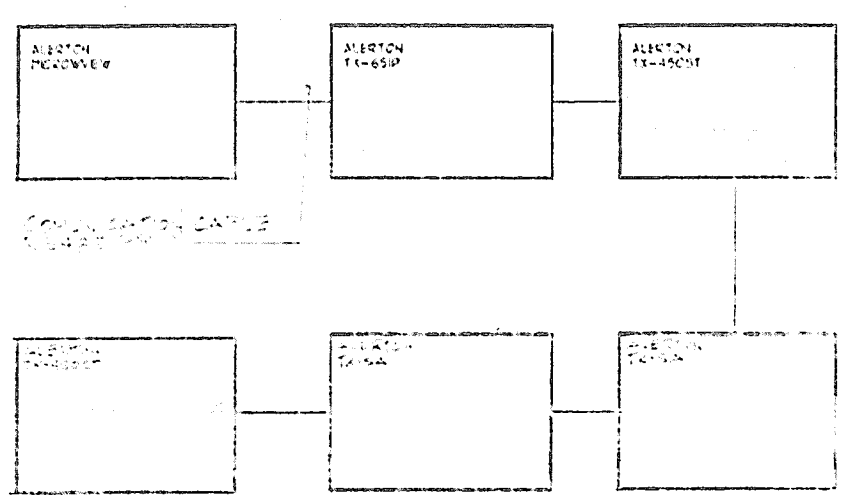

SEQUENCE OF OPERATIONS

WHEN THE SYSTEM IS STARTED, THE FOLLOWING SEQUENCE OF OPERATIONS SHALL BE OBSERVED:

1. THE EXHAUST FAN SHALL BE OPENED.

2. THE EXHAUST FAN SHALL BE OPENED.

3. THE EXHAUST FAN SHALL BE OPENED.

4. THE EXHAUST FAN SHALL BE OPENED.

5. THE EXHAUST FAN SHALL BE OPENED.

6. THE EXHAUST FAN SHALL BE OPENED.

7. THE EXHAUST FAN SHALL BE OPENED.

8. THE EXHAUST FAN SHALL BE OPENED.

9. THE EXHAUST FAN SHALL BE OPENED.

10. THE EXHAUST FAN SHALL BE OPENED.

NOTES:

1. THE EXHAUST FAN SHALL BE OPENED.

2. THE EXHAUST FAN SHALL BE OPENED.

3. THE EXHAUST FAN SHALL BE OPENED.

DRAWING CONTENTS

MECHANICAL DIAGRAMS

ACCURACY GUN

7818 Wilshire Ct., San Diego, CA 92133

DESIGN DEVELOP	1	5/16/94
PLAN CHECK	2	5/16/94
BIDDING	3	5/16/94
CONSTRUCTION	4	5/16/94
CLARIFICATION	5	5/16/94
RECORD	6	5/16/94

Project: _____

Scale: NONE

Drawn: T.M.

Job: 92-8

Sheet: **M-3**

Of 23 Sheets

A.L.M. ENGINEERING
 COMMERCIAL and RESIDENTIAL
 • H.V.A.C. Design
 • Plumbing Design
 • Title 24 Compliance
 • Economic Energy Analysis

1825 Glenview Circle
 San Diego, CA 92131
 (619) 535-1131

486